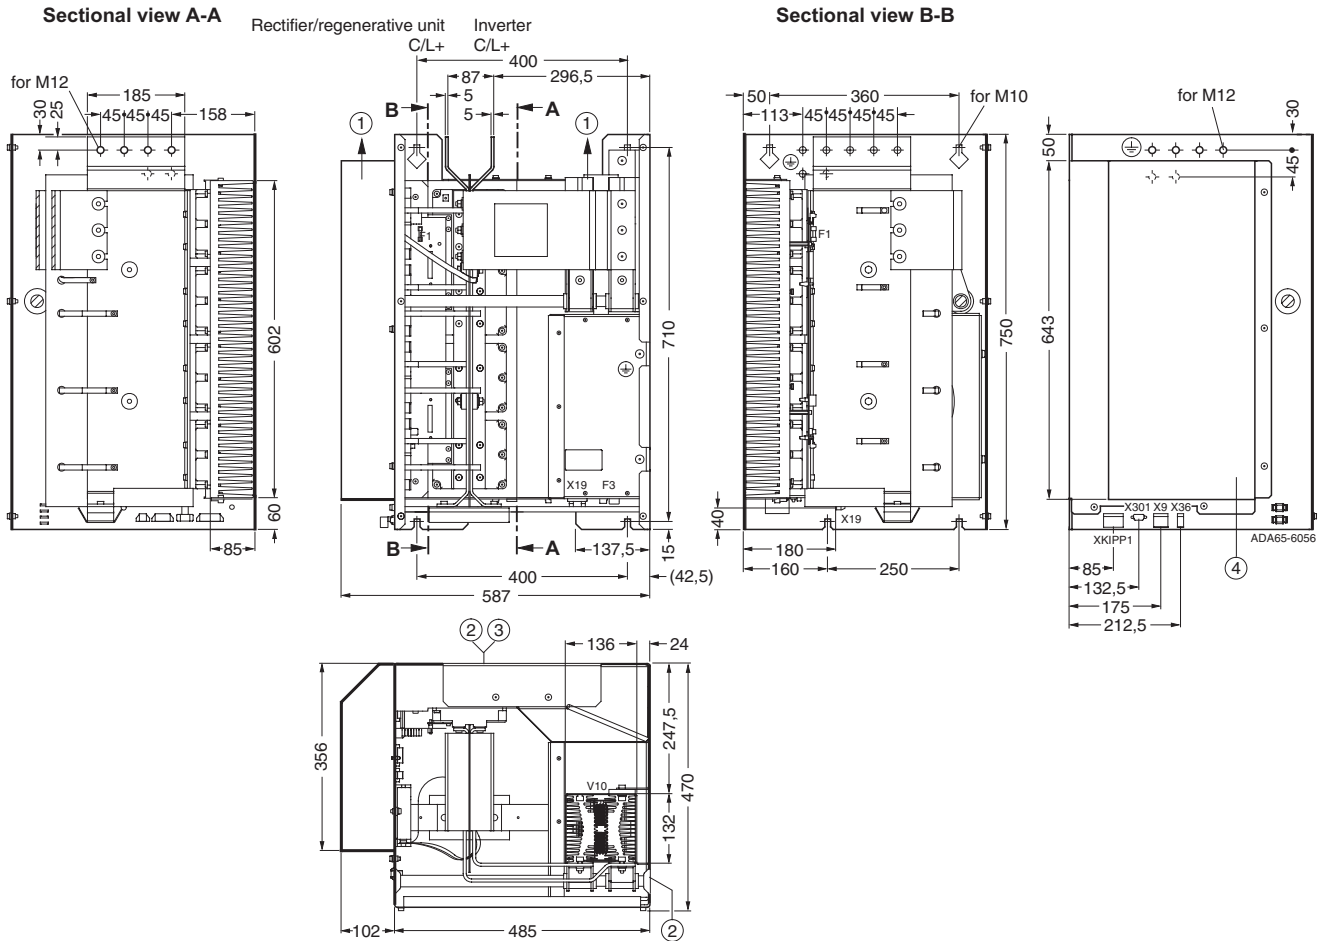


# SIMOVERT MASTERDRIVES Vector Control

## Dimension Drawings

Overcurrent protector units (OCP)

Compact and chassis units



**Fig. 19**

- ① Air outlet
- ② Optional mounting surfaces for wall mounting
- ③ Optional mounting surfaces for horizontal mounting

- ④ Optional air duct (Mounting 5 x M 6)  
If operated without an air conduit, it must be ensured that air can escape unhindered. Circulation of exhaust air must be excluded.

Max. wire cross-section for cable with cable lug to DIN 46 234: 8 x 250 mm<sup>2</sup>

Tightening torque for customer connections:  
C/L + = 44 Nm  
⊕ = 60 Nm